


# Bosch Compress 7000 LW 22 kW

Flow rates of water and brine were adjusted in the operating condition 0/35, 0/45 to get  $\Delta T=5^{\circ}\text{C}$  and  $\Delta T=3^{\circ}\text{C}$ , for 0/55 and 0/65 to get  $\Delta T=8^{\circ}\text{C}$  and  $\Delta T=3^{\circ}\text{C}$ .  
Circulation pumps are not included.  
Values can differ  $\pm 5\%$ .

Flow temperature ( $^{\circ}\text{C}$ )

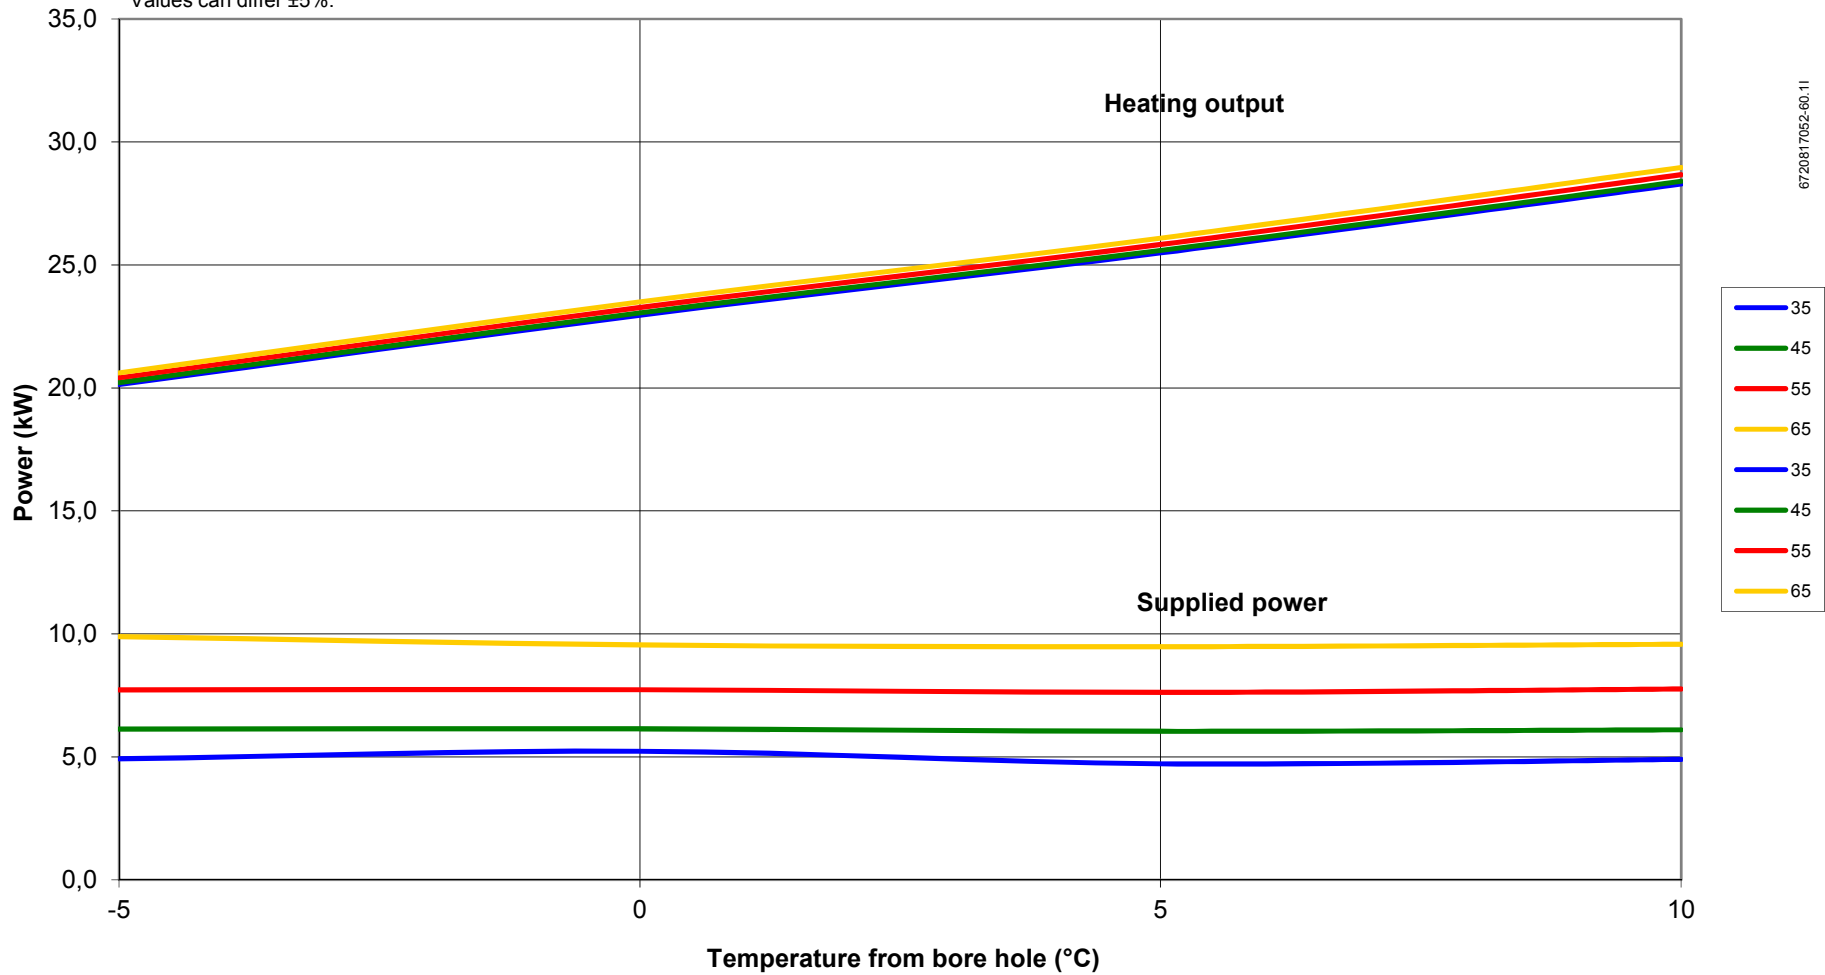

6720817052-60.11